




5 Fastener Layout (3.47 per m²)

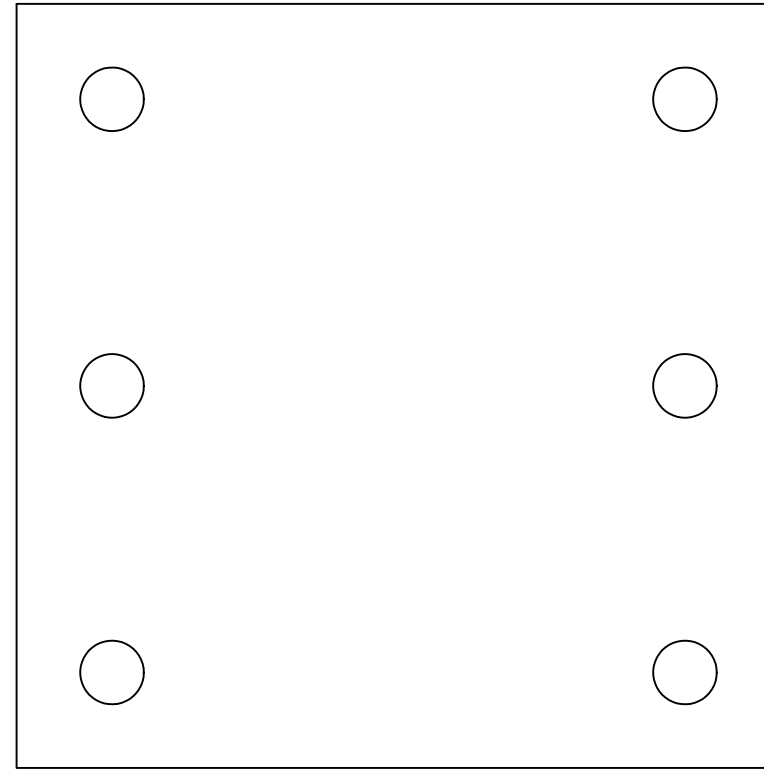

6 Fastener Layout (4.16 per m²)

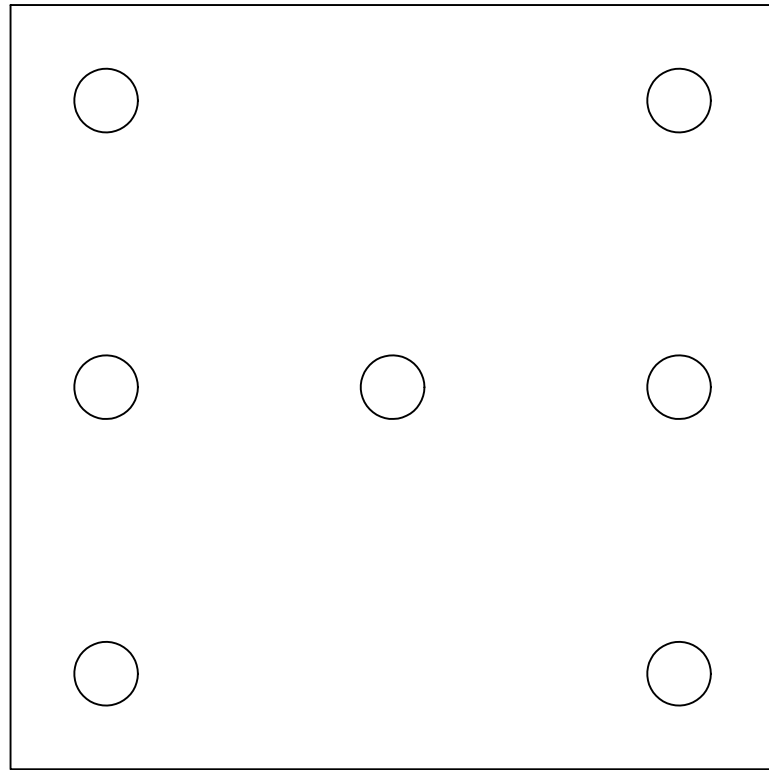

7 Fastener Layout (4.86 per m²)

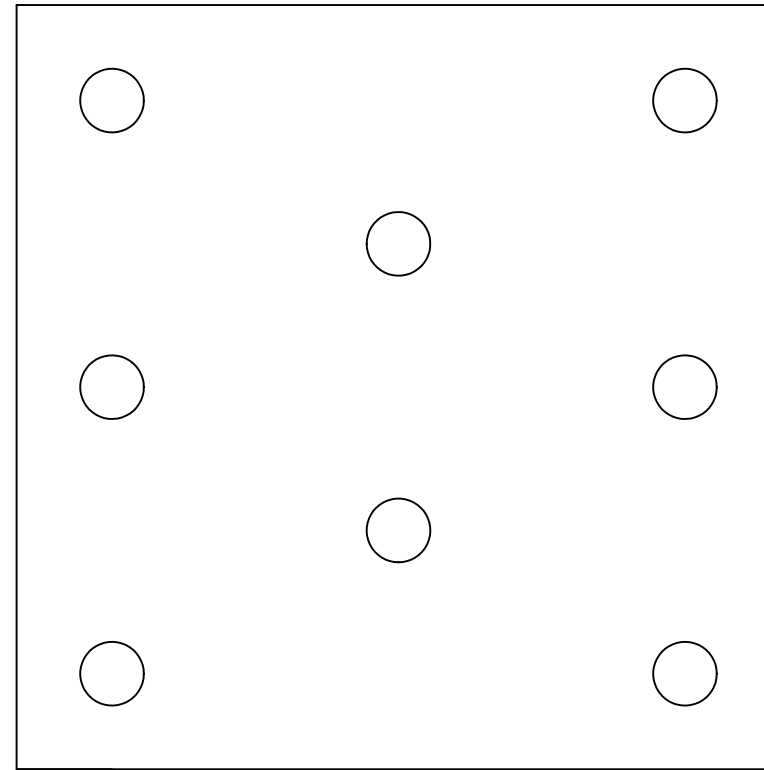

8 Fastener Layout (5.55 per m²)

Drawing Notes:

The number of mechanical fasteners required should be determined by a project specific wind uplift calculation in accordance with BS EN 1991-1/NA: 2011 and published industry guidance.

All mechanical fasteners should be located in even patterns to ensure that loads are evenly distributed. Fasteners and/or washers should not overlap multiple boards.

Fasteners must be located within 50-150mm from board edges (and corners).

Drawing Number: DUK-G-(G)-907	Revision: 00
Date Drawn: March 2017	Author: SL

Drawing Title:
Mechanical Fastening of 1200mm x 1200mm Insulation Boards
General Principals



DANOSA UK Limited

Tel: 0845 074 0553 | www.danosa.co.uk | uktechnical@danosa.com