
Disclaimer: Drawings produced by DANOSA UK should be considered non-scalable and for illustrative purposes only. Issued design principals form instructions for the installation of DANOSA UK materials only and should be considered as part of an overall design rather than in solation. Product Technical Datasheets' are available for all DANOSA UK products and should be consulted in conjunction with all issued DANOSA UK installation instructions.



Drawing Number:	Revision	
DUK-B-(G)-310C	02	
Date Drawn:	Author:	
February 2019	SL	

Drawing Title:

Junction with Tiled / Slate Roof
Reinforced Bitumen Membranes - Cold Roof

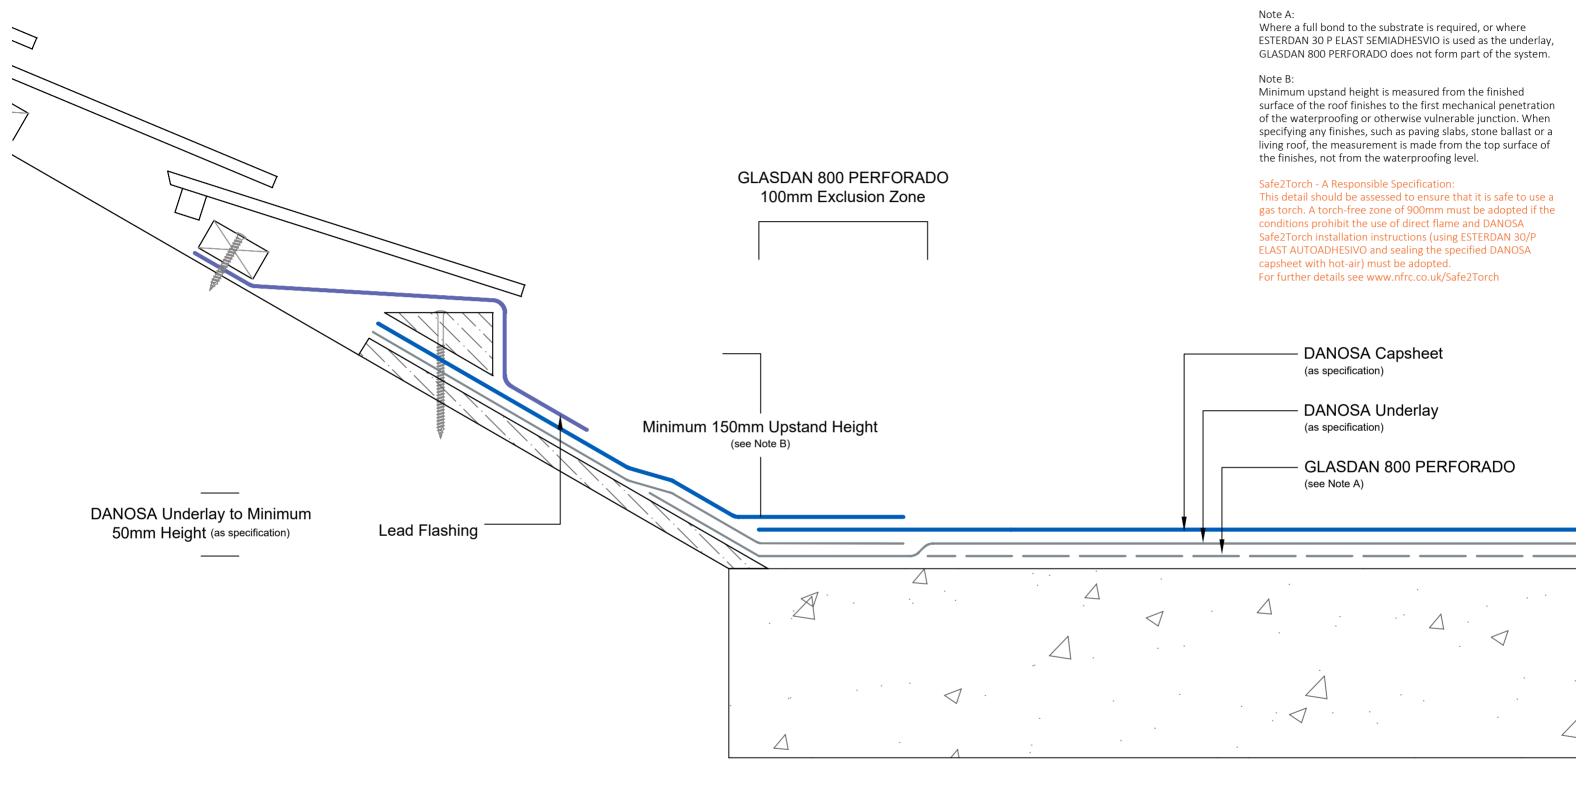

Drawing Notes:

All substrates should be primed or prepared in accordance with the project specification. Structural substrates shown in

All reinforced bitumen membrane side overlaps should be a minimum of 80mm and head laps a minimum of 100mm.

this drawing are for illustrative purposes only.